



1.1	waste position in floor, allowing for trap from machine	DN 70 φ 75 a
2.1	soft - hot water 50°C max. 0,54 mmol/l CaCO <sub>3</sub> / 53,4 ppm/CaCO (max.3°GH) consumption approx. 145 l for tank filling (TF)	DN 20 G 3/4 a
2.2	soft - mains cold water max. 0,54 mmol/l CaCO <sub>3</sub> / 53,4 ppm/CaCO (max.3°GH) consumption approx. 320 l/h for final rinse	DN 20 G 3/4 a
3.1	electrical supply to the machine power cord designed for standard electrical current / power max. cable cross section free cable end from FFL	3 N PE 400 V ~ 50 Hz 73,0 A 73,0 A / 48,0 kW 35 mm <sup>2</sup> approx. 2,5 m
6.1	air outlet quantity approx. 800 m <sup>3</sup> /h, temp. approx. 30°C ; relative humidity approx. 85 %, remaining pressure approx. 20 Pa; (incl. air present in the kitchen, approx. 200 m <sup>3</sup> /h)	exhaust air fan φ 360 mm
heat load of the wash room values do not include heat emission from washware		total perceptible latent ca. 4,9 kW ca. 1,3 kW ca. 3,6 kW

Performance data	
tank heating	7,4 kW
	17,4 kW
booster heater	20 kW
transport motor(s) (two speed)	0,12/0,18 kW
pump (s)	0,55 kW
	1,7 kW
booster pump final rinse ( air gap)	0,55 kW
waste air fan	0,11 kW

Machine Equipment	
free contacts for on-site fan locally	
free contacts for on-site dos.-equipment	
booster pump final rinse ( air gap)	
exhaust heat recovery HR	

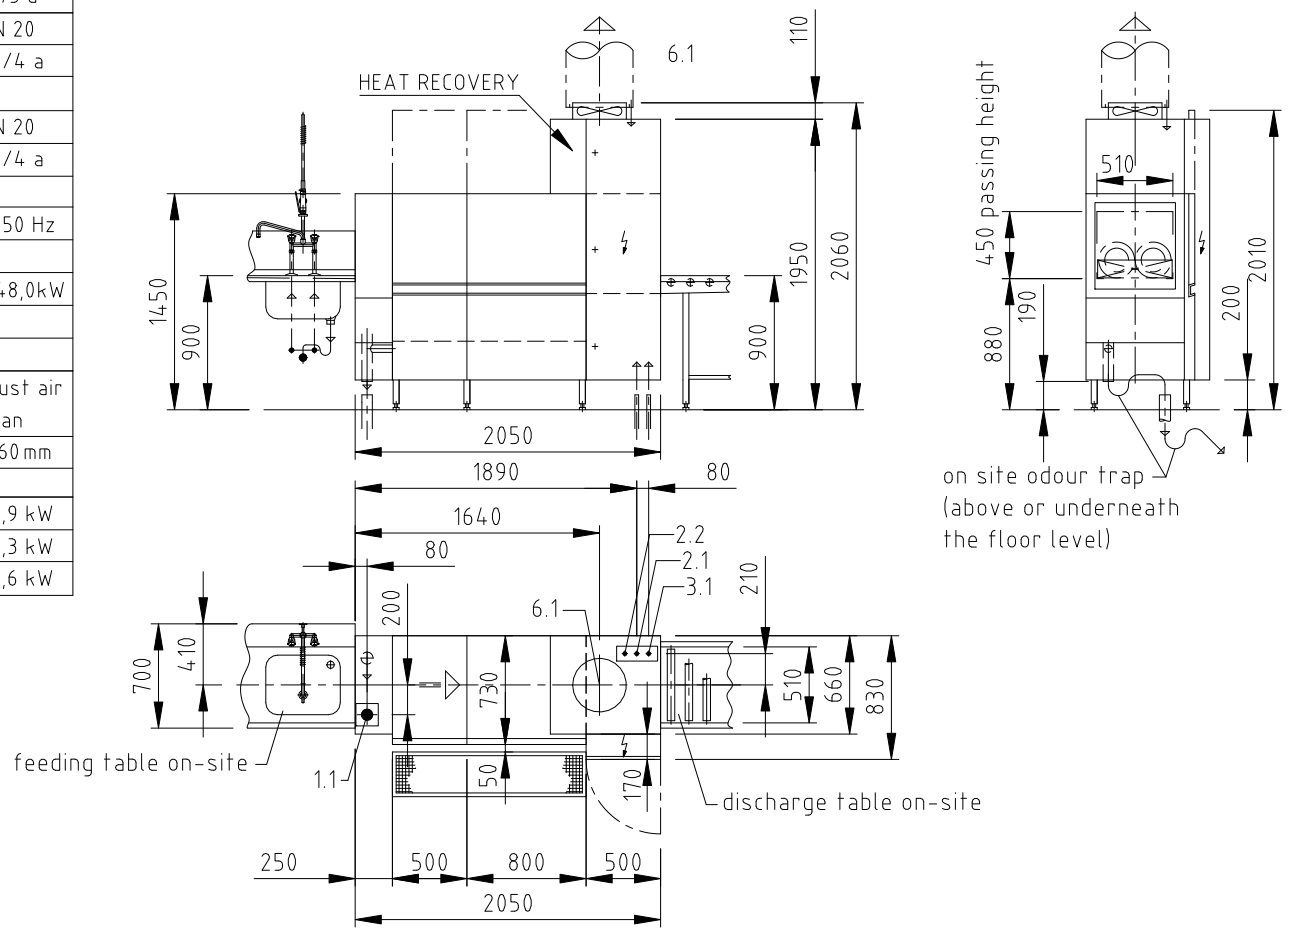

	MEIKO Wash-Up Technologies LTD. NO.12, Jingye Road , Torch High Tech Industrial Development Zone Zhongshan, Guangdong, P.R.C Postal code: 528437 Tel: +86 (0)760 85317591 Fax: +86 (0)760 85314217 Website: <a href="http://www.meiko.de">http://www.meiko.de</a> <a href="http://www.meikochina.com">http://www.meikochina.com</a>		Reference K-TRONIC STANDARD DRAWING/CHN (EN)	Type K260M-L-50-E-HR-nD L-R ELECTRICAL HR/TF: SWW
	It is neither allowed to give this drawing without our permission to a third party for information or reproduction, nor may it be used for competition purposes. We reserve all rights! Please note: This document is only valid in conjunction with the conditions defined in the document 9637291-BB_XXX.pdf (installation requirements)!		Drawing-No. Scale 1:50 drawn: 17.11.2017 Davis	Order-No. checked: